

EDR60-24DC

Class 2 Electronic Class P UNIV 5 in 1 dimming

Plastic Suitable For Dry And Damp Location Enclosure

Single Circuit: **24VDC**


Total Wattage: **60W max**

Input Voltage: **100-277V 50/60Hz**




Conforms to UL STD. 8750 and 1310
Certified to CSA
STD. C22.2 No 250.13

Installation Instruction for



- * Read instruction completely before installation.
- * Turn off electricity before wiring.
- * Only qualified personal should install the unit
- * Installation must comply with the NEC.
- * Ensure the unit has input, output voltage and output wattage proper for your application.

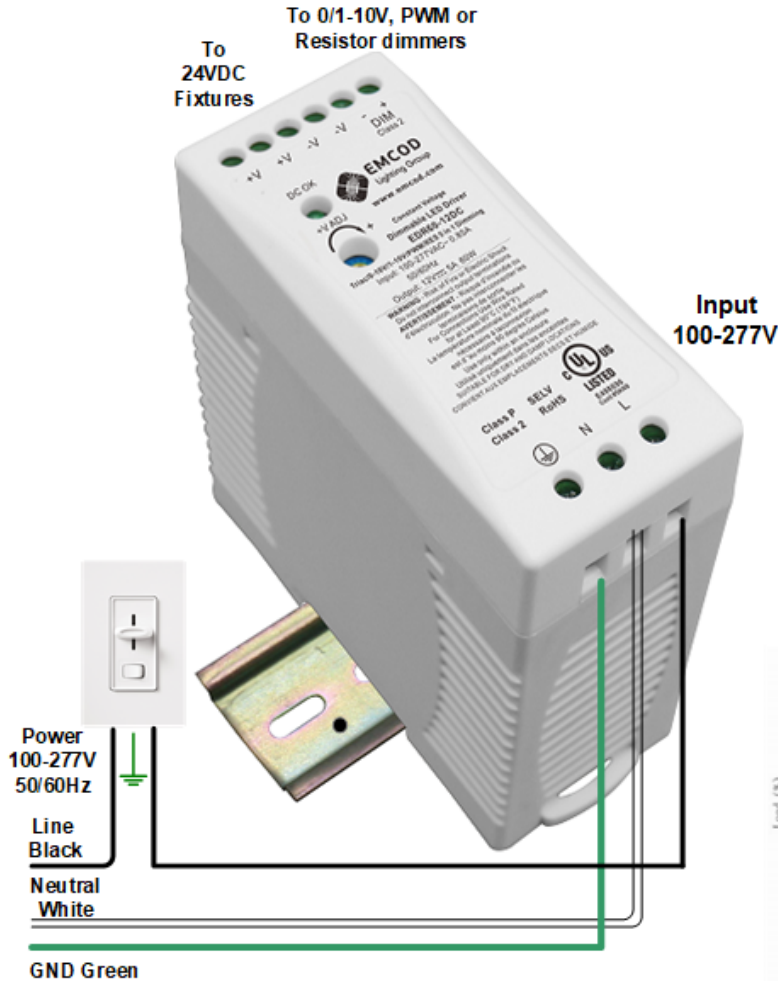

Mounting


The Driver must be mounted in at least 10" of a free flow air space for proper ventilation. The Driver must never be mounted next to or above heat radiated objects.
 Rail installation method: Installed on TS-35/7.5 or TS-35/15 rail.
 The maximum ambient temperature should not exceed 70 deg. C (158 deg. F)
 See derating curve below.

Input Connection

Bring your line, neutral and Ground wires and connect them to the L , N and Ground terminal blocks.

Output Connection

Bring your lights wires and connect to the + and - terminal blocks. For easy installation there are two + and two - terminal blocks. You can use each one or both together. Make sure all your connection tight.

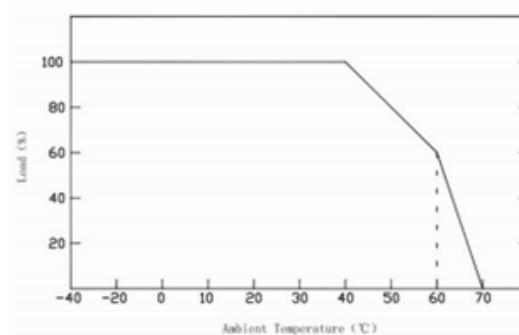

Derating Curve

Mailing Address: 646 Flinn Ave. Unit B, Moorpark , CA 93021 Tech support: Arik Nirenberg phone: 818-904-3309
 Fax: 818 904 3327 info@emcod.com techsupport@emcod.com